



**ISSUE 2**  
AUG 2022



**galvin**specialised  
commercial taps + fixtures

**Water Solutions for a Healthier Environment**



**Improving Water Quality in  
Australian Schools and Hospitals**  
– Reducing Lead Levels in our Drinking Water



## The World Health Organisation (WHO) states that lead is a cumulative toxicant that can result in adverse health effects.

**In severe cases, anaemia, seizures, coma, or death may occur. Lead is considered particularly harmful to young children and it is estimated to have contributed to 540,000 deaths worldwide in 2016. There is no known level of lead exposure that is considered safe.<sup>1</sup> This has resulted in lead being restricted or banned from use in some products that could enable the direct ingestion or absorption of lead. Two examples of this has been the banning of lead in petrol and the very strict controls on lead in paint.**

Metal contamination of drinking water and its potential health effects has impacted human populations for centuries.<sup>2,3</sup> It has even been argued that Ancient Rome's use of lead in water supply infrastructure caused lead poisoning that contributed to the fall of the Roman Empire.<sup>2,4,5,6,7</sup>

Several high profile incidences in Australia of elevated levels of lead being found in drinking water, have heightened concern amongst the health community and the public surrounding the effect on drinking

water from leaded plumbing materials. These calls, in conjunction with other countries such as the USA already reducing lead content in plumbing products, have led to changes to the National Construction Code (NCC) by including a new requirement for lead free plumbing products to ensure lead ingestion is reduced or eliminated (NCC 2022 Vol. 3 Clause A5G4(2))<sup>8</sup>.

At Galvin Engineering, our purpose is to provide Water Solutions for a Healthier Environment. Our focus is on the supply of specialised tapware, water management systems and fixtures for education, health, and public facilities. With increasing anxiety in the community around elevated lead levels in drinking water, we have responded by designing and manufacturing an innovative range of premium quality taps in new lead free and low lead materials - the GalvinClear® Lead Safe™ product range.

This paper looks at the potential health benefits for the community of using Lead Safe™ materials and adopting special production methods in the design and manufacture of drinking bubblers and other tapware, predominantly for use in schools, hospitals, and public areas.



## Incidences of elevated lead levels in drinking water

In 2014, 100,000 residents in Flint, Michigan, USA, received drinking water with elevated levels of lead. It was discovered that the water supply had become contaminated with lead that had leached from the ageing plumbing pipe infrastructure. The corrosion of the pipework occurred due to a change in the water source and the failure to use corrosion control measures.<sup>9</sup>


In Australia over the last few years, there has been several high-profile cases of lead contamination being found in our drinking water. A study by Macquarie University in 2016, found that of 212 first draw drinking water samples taken from homes in New South Wales, 8% exceeded the lead levels set in the Australian Drinking Water Guidelines (ADWG).<sup>10</sup> Furthermore, they found that the household plumbing fittings, taps, and pipework were a significant source of drinking water lead contamination. They recommended that products for use in contact with drinking water should be manufactured free from lead.<sup>2</sup>

In Western Australia, the opening of the \$1.2 billion Perth Children's Hospital (PCH)

was delayed for 2½ years until March 2018, with one of the reasons cited being elevated lead levels in the building's water. The lead was alleged to have leached from plumbing fittings and valves inside the hospital due to corrosion resulting from multiple flushes of the system using high chlorine doses.<sup>11</sup> Around this time there were other high profile issues involving lead in water such as the closure of several Perth schools and parks, and media reports surrounding the Perth's Optus Stadium in 2018. Plumbing products were seen as one of the potential sources of high lead levels in the water.

The products deemed to be at fault at PCH and the Stadium were replaced with lead free alternatives.

In 2018, Geelong Council in Victoria closed down the drinking fountains in several parks over concerns around high levels of lead being found in the water. In May 2019, the Victorian School Building Authority (VSBA) changed its Building Quality Standards Handbook to only allow the use of lead-free or lead-safe tapware and piping systems in government schools.<sup>12</sup>

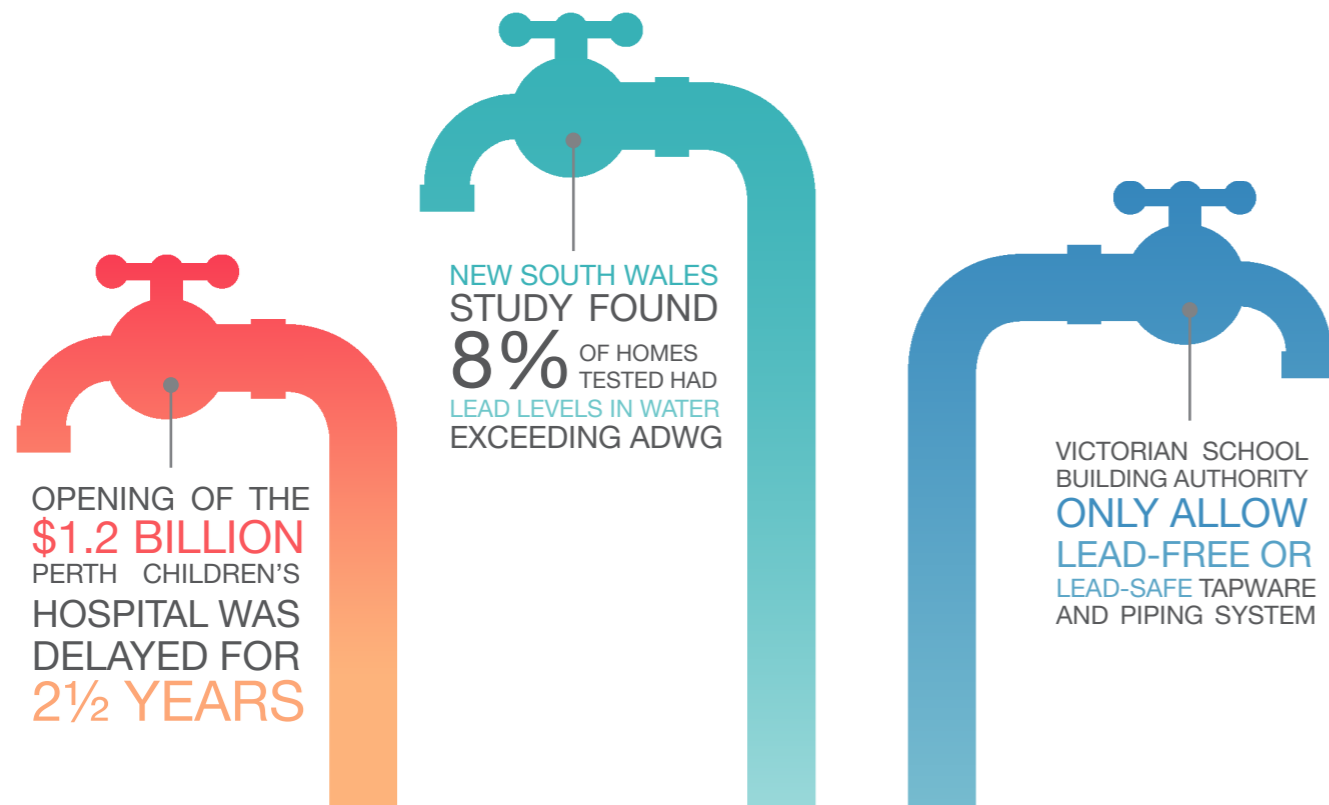

## What are the reasons for lead being in drinking water?

It is recognised that many factors contribute to the variability and accuracy of lead concentration results from infield drinking water sampling.<sup>13</sup> This can make it extremely difficult to determine the true source, and/or the reasons for lead being in the water supply.

Besides the quality of the actual water source, these factors include but are not limited to:



Dealing with the build-up of lead in the water due to these factors, is especially important in large and complex plumbing systems, such as those in hospitals, schools, and prisons.



## Current standards and lead


**In Australia, plumbing products in contact with potable water typically need to be certified to the relevant WaterMark.**

Some examples include:

- **AS 3688:2016** – Water supply and gas systems – Metallic fittings and end connectors<sup>14</sup>
- **AS/NZS 3718:2005** – Water supply – Tapware<sup>15</sup>
- **AS 4032.4:2014** – Water supply – Valves for the control of heated water supply temperatures Part 4: Thermostatically controlled taps for the control of heated water supply temperature<sup>16</sup>

The material compositions allowed are covered under the relevant WaterMark. The WaterMarks may also cross reference to other Australian Standards. When looking at **AS/NZS 3718** for example, clause 2.2.4 references the following standards for various copper alloys:


- **AS 1565** – Castings – Less than 4.5% lead
- **AS 1567** – Extrusions – Less than 3.5% lead
- **AS 1568** – Hot Pressings – Less than 3.5% lead

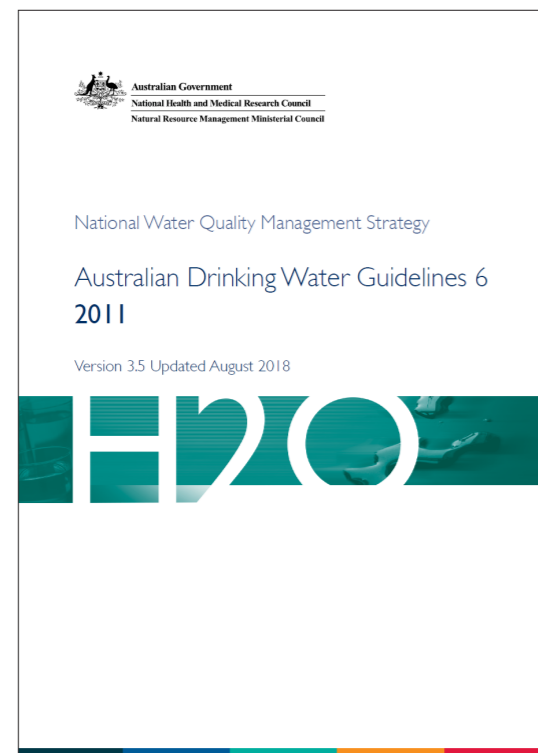

Also, as a prerequisite of gaining certification to the WaterMark, manufacturers need to have their products tested to **AS/NZS 4020:2018** – Testing of products for use in contact with drinking water.<sup>17</sup> This standard specifies requirements for the suitability of products for use in contact with drinking water with regards to their effect on the quality of water. Extraction of metals is covered under clause 6.7, with limits of maximum allowable concentration of metals detailed in Table 2. These limits are taken from the Australian Drinking Water Guidelines (ADWG) with the maximum level for lead (Pb) in water extracts from the taps being set at 0.01mg/L.

Overseas the situation varies from country to country. In Europe, France, Germany, the Netherlands, and the United Kingdom, work together in a framework known as the 4MS Common Approach. References to maximum lead levels are covered in the document 'Acceptance of Metallic Materials Used for Products in Contact with Drinking Water – 4MS Common Approach'. Typically, most alloys have a maximum lead level of 0.2%, but there are several exceptions that allow up to 3.5%.<sup>18</sup>

In the USA, the Safe Drinking Water Act (SDWA) prescribes that only pipes, plumbing fixtures, fittings, etc that are considered lead-free, are allowed to be used in the installation or repair of public water systems and in the plumbing of residential or non-residential facilities providing water for human consumption. In 2011, the government changed the definition of lead free for pipes, pipe fittings, etc in the SDWA, from 'containing not more than 8.0% lead', to 'not more than a weighted average of 0.25% lead when used with respect to wetted surfaces of pipe, pipe fittings, plumbing fittings, and fixtures'.<sup>19</sup>

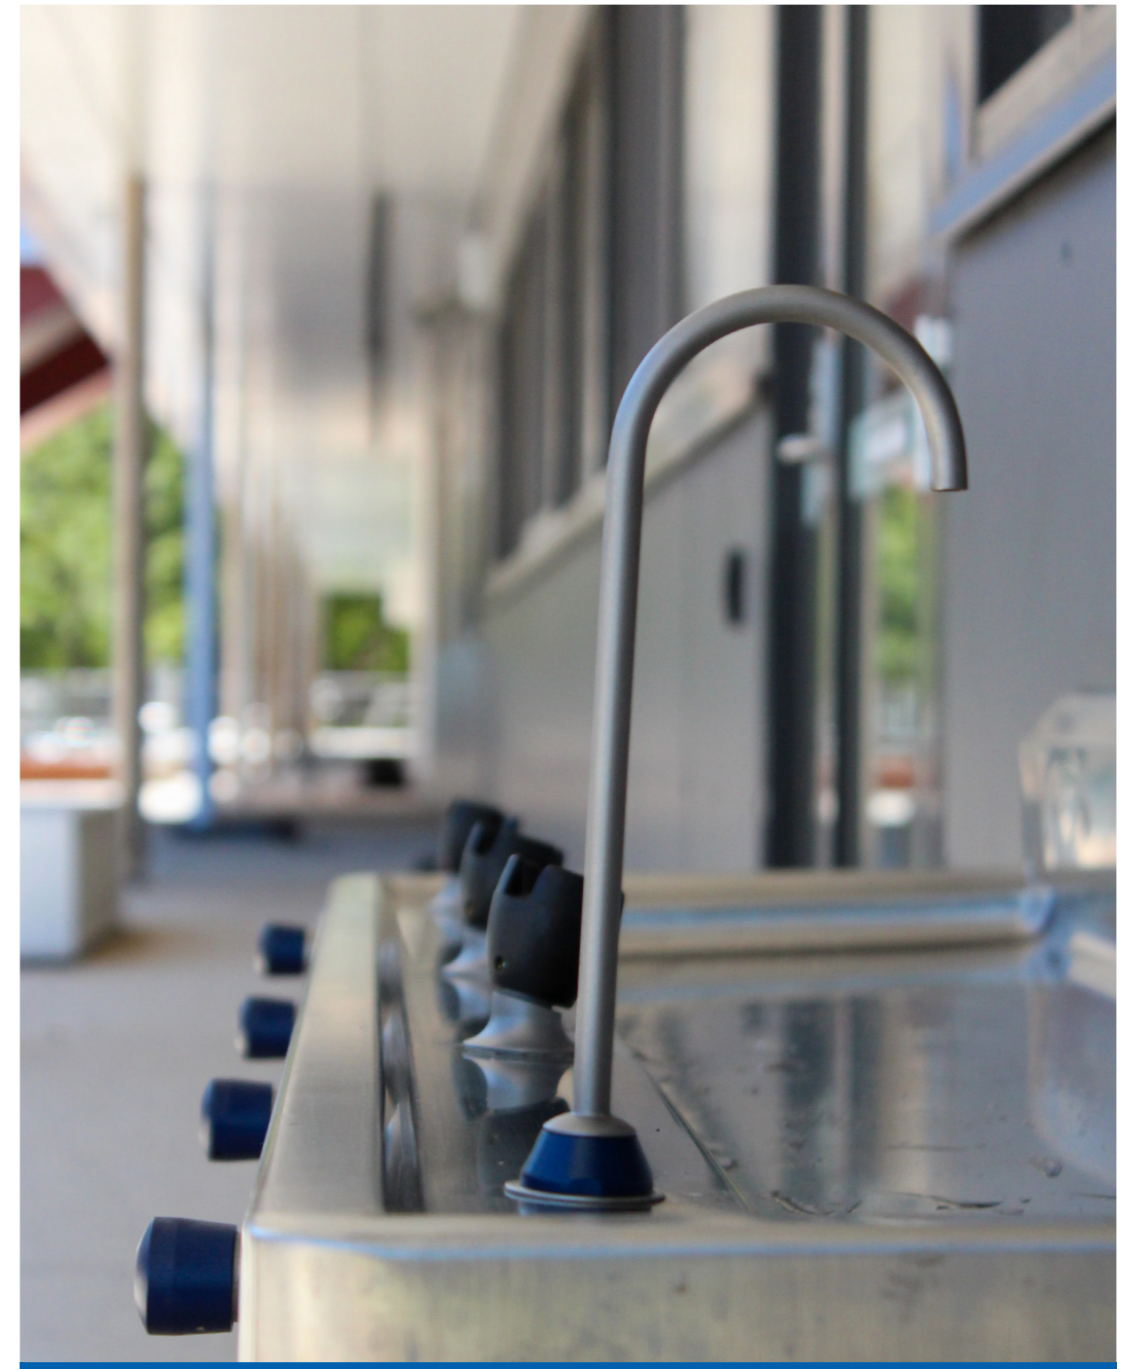

## The standards around lead will change in Australia from 1 September 2025

The Australian Building Codes Board (ABCB) has been investigating to what extent plumbing products and materials contribute to lead levels in drinking water that are in excess of ADWG requirements.

The initial review was performed by the Macquarie University and amongst other findings, it stated that 'brass components containing lead that are used in plumbing systems, can leach lead into drinking water'. A key recommendation was that 'only low lead or preferably lead-free plumbing

components should be used during installation of drinking water systems'.<sup>20</sup>

The ABCB has made a significant change to Volume Three of the National Construction Code (NCC) by adding a new requirement for lead free plumbing products. **NCC 2022 specifies new requirements for any plumbing product containing copper alloy and intended for use in contact with drinking water from 1 September 2025 (Clause A5G4(2))<sup>8</sup>.**



## A new Lead Safe™ tapware solution

Until recently, our taps and plumbing products have been manufactured using premium quality DZR brass that is approved to Australian Standards. All our products are approved to the relevant WaterMark or StandardsMark, and products in contact with potable water pass the strict testing of AS/NZS 4020:2018 to ensure they are totally safe for use with drinking water.

To be ready for NCC 2022 and offer our customers a greater choice of quality taps for a healthier environment, over the last three years, we have also been making taps using special manufacturing techniques and new materials that are either lead-free or low in lead. As ‘lead free’ is not currently defined by law or plumbing codes in Australia and New Zealand, we have based our definition of Lead Safe™ on the requirements of

s1417 of the USA’s SDWA, and the relevant US standards, NSF61<sup>21</sup> and NSF372<sup>22</sup>.

We have been utilising materials that are listed on the European’s ‘4MS Common Composition List’ to ensure we use the safest material currently available.<sup>18</sup> Largely we have been using either 316 stainless steel, or compositions of DZR brass that contain less than 0.2% lead.

Along with this, we have also implemented new methods of manufacture and a special process of washing parts to ensure contaminants are eliminated. This new GalvinClear® Lead Safe™ product range has also passed the relevant AS/NZS 4020:2018 testing requirements and is listed on our WaterMark schedules.

## A study into the effects on lead levels in drinking water of different materials

In 2019, Galvin Engineering commissioned a study to sample and accurately measure what levels of lead may be leached from drinking bubblers manufactured from these different materials. Professor of Environmental Engineering, Anas Ghadouani (BSc MSc PhD), and his faculty team at the University of Western Australia (UWA) were engaged to develop and undertake comprehensive testing. Water samples were analysed at an independent NATA approved laboratory in Perth, ALS Environmental.

Three of our Ezy-Drink® drinking bubbler models were tested. The bubblers were manufactured in our ISO 9001 and ISO 14001 endorsed factory, using our standard strict quality control procedures

and a controlled clean environment. Part of the manufacturing process includes each bubbler being washed in a special solution to remove any residual contaminants that could be left inside the product.

One bubbler was manufactured using traditional high quality standard DZR brass containing less than 2.5% lead. Two bubblers were produced using our new GalvinClear® Lead Safe™ materials. The first was made from a premium grade lead free 316 stainless steel. The second was produced using a special low lead DZR brass that contains less than 0.2% lead content. This alloy is approved to the European’s 4MS Common Approach and complies to the strict requirement of the USA’s Safe Drinking Water Act.

Ezy-Drink® CP-BS (standard)	High quality DZR brass	Lead content <2.5%
Ezy-Drink® Stainless Steel	316 Stainless Steel	Lead content 0%
Ezy-Drink® CP-BS Lead Safe™	High quality low lead DZR brass	Lead content <0.2%

The testing regime was selected after careful examination of current Australian Standards such as AS/NZS 4020:2018 and AS/NZS 5667.5:1998 – Water quality – Sampling – Part 5: Guidance on sampling of drinking water and water used for food and beverage processing.<sup>23</sup> Reference was also made to other Australian authorities including the 2016 study performed by Macquarie University, and later during testing to enHealth’s June 2019 draft guideline

‘Reducing exposure to metals in drinking water from plumbing products’.<sup>24</sup> In addition, overseas guidelines such as those issued by Health Canada in 2017<sup>25</sup> and by the USA’s EPA in 2016, were also cross referenced.

Based on this information, and after consulting several NATA approved laboratories, the following methodology was used:

### First Draw-Off

This is the option recommended by the reference material when testing for the effects of different materials on the water quality coming out of the taps. Typically, first draw samples will result in a higher concentration of lead than a flushed sample if the end of line fitting is the primary cause.

### 24 Hour Stagnation Time

This is the highest stagnation time in the reference material and what is used for some testing in AS/NZS 4020. Typically, a longer stagnation time will result in higher lead concentrations than shorter stagnation times.

### 80ml Sample Sizes

This is the typical size of bottles used by NATA testing laboratories in WA when conducting infield water quality testing. Typically, a smaller sample size will have a higher lead concentration than a larger sample size if the end of line fitting/tap is the primary cause.



The testing was performed in a controlled laboratory at the UWA utilising custom made testing apparatus.

Deionised water was used to minimise the potential of lead being introduced into the tests via the water supply. It should be noted that deionised water is considered aggressive on certain materials, so any resultant leaching could be higher than is expected in the field.


# What were the results from the Ezy-Drink® bubblers manufactured using Lead Safe™ technology?

## The final results from four separate rounds of tests during 2019 were:

- The water extracts taken from the Galvin Specialised Ezy-Drink® bubblers manufactured from Lead Safe™ 316 stainless steel, showed no detectable levels of lead in the water (<0.001mg/L).
- The water extracts from the Ezy-Drink® bubblers manufactured from Lead Safe™ low lead DZR brass, showed no detectable levels of lead in the water (<0.001mg/L).

- The water extracts from the Ezy-Drink® bubblers manufactured from standard DZR brass showed very low lead levels in the water (<0.002mg/L). This is five times under the maximum limit set out in the ADWG.

Therefore, all styles of Ezy-Drink® bubblers are delivering water that is many times under the maximum allowable lead level of <0.01mg/L as set in the ADWG and therefore could be considered safer for drinking water.

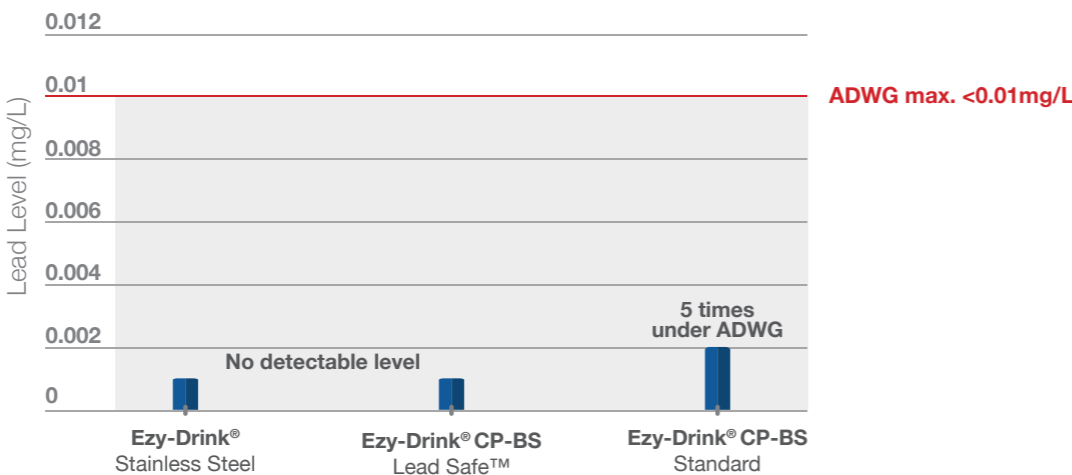

## A safer choice for schools and hospitals

- The WHO state there is no known level of lead exposure that is considered safe and it is agreed by health experts that any form of lead ingestion should be reduced or eliminated.<sup>1</sup>
- This study confirms, lead exposure in drinking water is preventable, and subject to the inlet water being lead free:
  - Drinking water supplied via Ezy-Drink® bubblers made from GalvinClear® Lead Safe™ materials, contains no detectable levels of lead.
  - All our Ezy-Drink® drinking bubbler models have levels of lead significantly under the requirements set by the WHO and the ADWG.
- Products manufactured using GalvinClear® Lead Safe™ materials and technology are NCC 2022 Vol. 3 Clause A5G4(2)<sup>8</sup> compliant and a safer and healthier choice for the community, especially for areas of greatest risk such as schools and hospitals.



## References

- <sup>1</sup> World Health Organisation, 2019. Fact Sheet - Lead Poisoning and Health
- <sup>2</sup> Harvey, P.J., Handley, K.H., Taylor, M.P., 2016. Widespread copper and lead contamination of household drinking water, New South Wales, Australia. Environmental Research
- <sup>3</sup> Bellinger, D.C., 2016. Lead contamination in Flint — an abject failure to protect public health. New England Journal of Medicine
- <sup>4</sup> Delile, H., Blichert-Toft, J., Goiran, J.-P., Keay, S., Albarède, F., 2014. Lead in ancient Rome's city waters. In: Proceedings of the National Academy of Sciences
- <sup>5</sup> Evans, H.B., 1997. Water Distribution in Ancient Rome: The Evidence of Frontinus. University of Michigan Press
- <sup>6</sup> Scarborough, J., 1984. The myth of lead poisoning among the Romans: an essay review. Journal of the History of Medicine and Allied Sciences
- <sup>7</sup> Waldron, H.A., 1973. Lead poisoning in the ancient world. Medical History
- <sup>8</sup> NCC 2022 Volume Three
- <sup>9</sup> United States Environmental Protection Agency (US EPA), 2016. Drinking Water Contamination in Flint, Michigan, Demonstrates a Need to Clarify EPA Authority to Issue Emergency orders to Protect the Public
- <sup>10</sup> Australian Government: National Health and Medical Research Council, 2016 & 2018. Australian Drinking Water Guidelines 6, Version 3.3 (2016) and Version 3.5 (2018)
- <sup>11</sup> Government of Western Australia: Department of Health, 2017. Report on Perth Children's Hospital Potable Water – Chief Health Officer Review
- <sup>12</sup> Victorian School Building Authority, 2019. Building Quality Standards Handbook – May 2019
- <sup>13</sup> Galvin, C.M., 2017. Effects of Water Sampling Methods
- <sup>14</sup> Standards Australia, 2016. AS 3688:2016 - Water supply and gas systems - Metallic fittings and end connectors
- <sup>15</sup> Standards Australia, 2005. AS/NZS 3718:2005 – Water supply – Tap ware
- <sup>16</sup> Standards Australia, 2014. AS 4032.4:2014 - Water supply - Valves for the control of heated water supply temperatures - Part 4: Thermostatically controlled taps for the control of heated water supply temperatures
- <sup>17</sup> Standards Australia, 2018. AS/NZS 4020:2018 – Testing of products for use in contact with drinking water
- <sup>18</sup> 4MS Joint Management Committee, 2017. Acceptance of Metallic Materials Used for Products in Contact with Drinking Water – 4MS Common Approach
- <sup>19</sup> United States Government, 2011. Safe Drinking Water Act (SDWA), Public Health Service Act
- <sup>20</sup> Taylor, M.P., Harvey, P.J., Morrison, A.L., 2018. Lead in Plumbing Products and Materials. Macquarie University
- <sup>21</sup> NSF/ANSI 61, 2016. Drinking Water System Components – Health Effects
- <sup>22</sup> NSF/ANSI 372, 2016. Drinking Water System Requirements – Lead Content
- <sup>23</sup> Standards Australia, 1998. AS/NZS 5667.5:1998 – Water quality – Sampling – Part 5: Guidance on sampling of drinking water and water used for food and beverage processing
- <sup>24</sup> Australian Government: enHealth, 2019. Reducing exposure to metals in drinking water from plumbing products – Draft v4.1
- <sup>25</sup> Health Canada, 2017. Lead in Drinking Water

Dore, E., Deshommes, E., Andrews, R.C., Nour, S., Prevost, M., 2018. Sampling in schools and large institutional buildings: Implications for regulations, exposure and management of lead and copper. Water Research

We design, manufacture  
and supply safe,  
green and smart water  
solutions for high  
risk and high care  
environments.

1300 514 074  
sales@galvinengineering.com.au  
galvinengineering.com.au

- Australia
- New Zealand
- UK
- USA

® Ezy-Drink, GalvinClear, Galvin Engineering, Galvin Specialised. All rights reserved.  
™ Lead Safe © Galvin Engineering Pty Ltd



A family  
owned  
Australian  
business

Whilst all reasonable care has been taken in compiling the information in this document, the designs, dimensions and products shown are indicative only and should not be relied upon without prior approval. Due to our policy of continuous development, we reserve the right to alter any details of specifications or products without notice. All information, drawings, technical specifications and product designs remains the property of Galvin Engineering Pty Ltd.