


Product Installation Guidelines

Version 3, 19 July 2024, Page 1 of 6
Document No.: 001.00.10.21

CliniLever® BS Lead Safe™ SBA

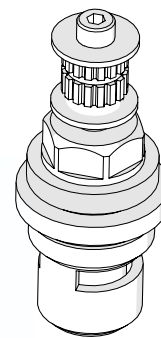

Ceramic Disc



Jumper Valve

PRODUCTS

Item Code	Description	Headwork
102.90.10.02	CliniLever® CP-BS Lead Safe™ Hospital Surgical SBA Hot J/V	Jumper Valve
102.90.11.01	CliniLever® CP-BS Lead Safe™ Hospital Surgical SBA Cold J/V	Jumper Valve
102.90.11.02	CliniLever® CP-BS Lead Safe™ Hospital Surgical Basin SBA Hot J/V	Jumper Valve
102.90.20.02	CliniLever® CP-BS Lead Safe™ Hospital Surgical SBA Hot C/D	Ceramic Disc
102.90.21.01	CliniLever® CP-BS Lead Safe™ Hospital Surgical Basin SBA Cold C/D	Ceramic Disc
102.90.21.02	CliniLever® CP-BS Lead Safe™ Hospital Surgical Basin SBA Hot C/D	Ceramic Disc

SPECIFICATIONS

- The Galvin Engineering CliniLever® product range is primarily used for hand washing applications in hospitals, aged care facilities, schools and in-home care.
- CliniLever® products provide state of the art features to comply with the latest healthcare guidelines.
- The main body is made of solid dezincification resistant (DR) brass rod, with a DR brass fixed outlet.
- Quick action SBA's include ceramic disc/jumper valve components
- Lead Safe™ brass construction. *

IMPORTANT: All CliniLever® Healthcare taps are tested in accordance with AS/NZS 3718 and leave our premises in good working order.

*Our Lead Safe™ product range is compliant with the Lead-Free Requirements of the NCC 2022 Vol. Three, Clause A5G4(2) and NSF/ANSI 372.

** Any flow controller incorporated in the outlet to be tightened to prevent removal by hand. As Per AS3718.

WARNINGS: Special attention to be paid to notes, photos, images, or drawings of assembly steps marked with the warning symbol.



TECHNICAL DATA


Inlet	G 5/8" – Male	
Headwork	Jumper Valve/Ceramic Disc	
Working Pressure Range (kPa)	Min	50
	Max	500
Working Temperature (°C)	Min	5
	Max	65
Finish	Brass	

NOTE: Galvin Engineering continually strives to improve their products. Specifications may change without notice.


TOOLS REQUIRED

- Spanner and hex key
- Thread tape


DIMENSIONS

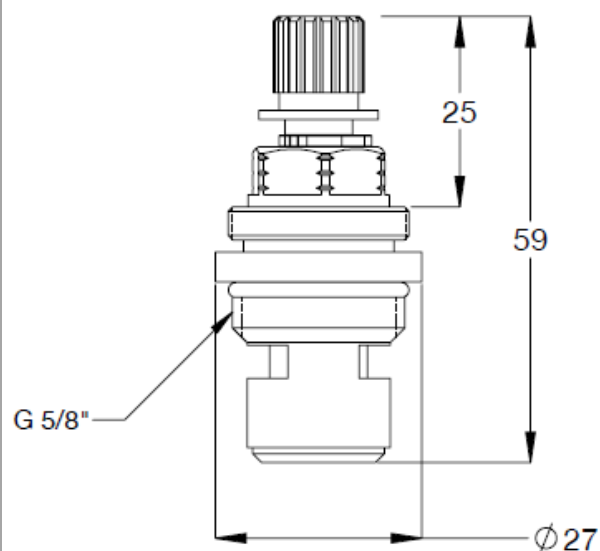


102.90.21.02

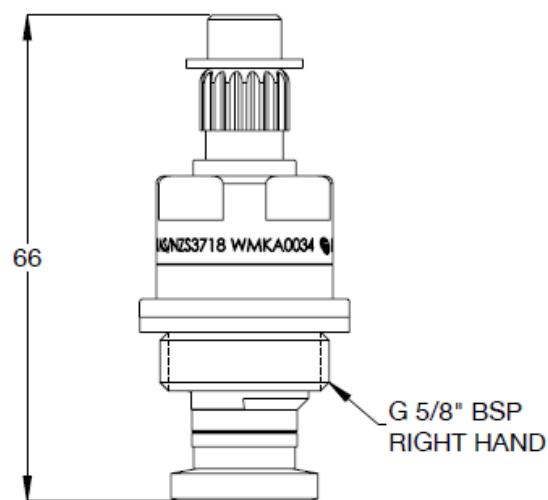


102.90.11.01

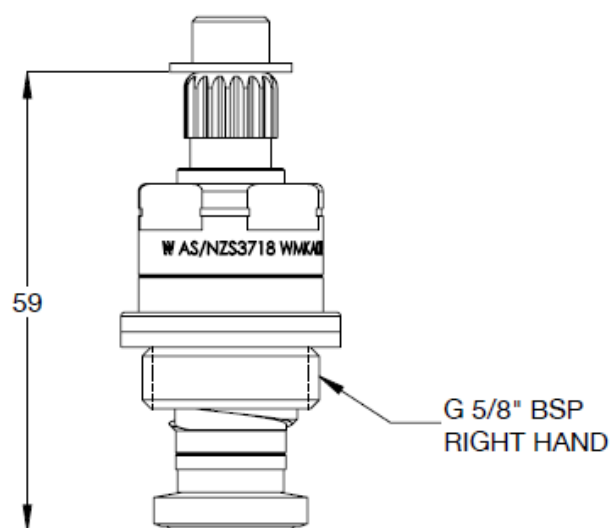


102.90.10.02

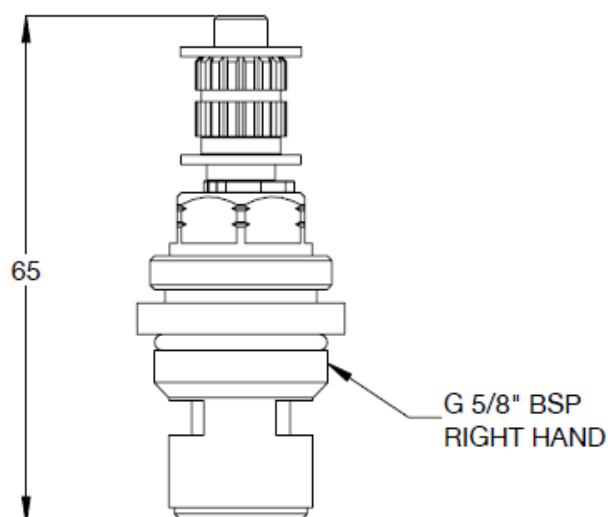

102.90.21.01

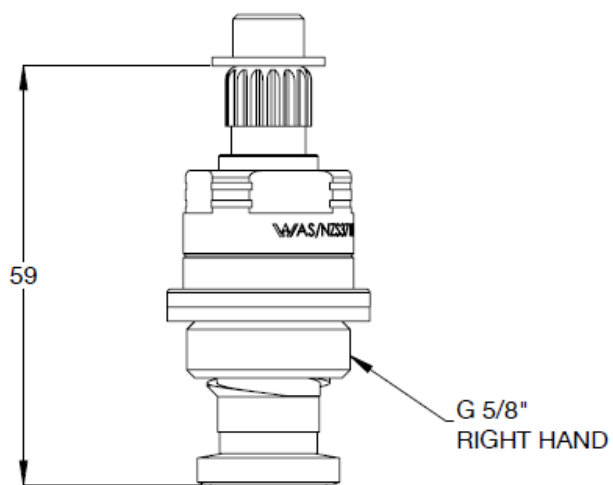

102.90.11.02

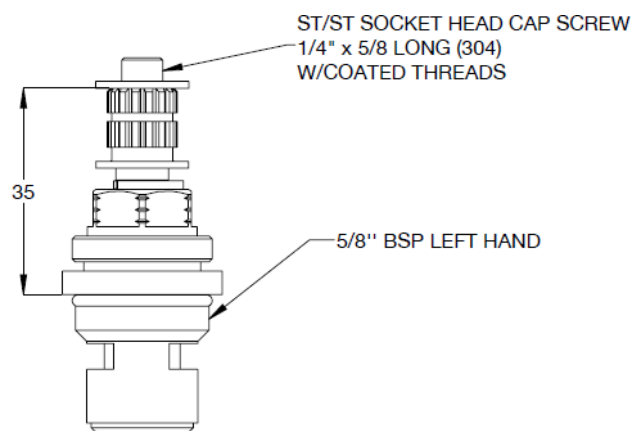


102.90.20.02


INSTALLATION

INSTALLATION COMPLIANCE: Galvin Engineering products must be installed in accordance with these installation instructions and in accordance with AS/NZS 3500, the PCA and your local regulatory requirements. Water and/or electrical supply conditions must also comply to the applicable national and/or state standards. Failing to comply with these provisions shall void the product warranty and may affect the performance of the product.

IN WALL INSTALLATION

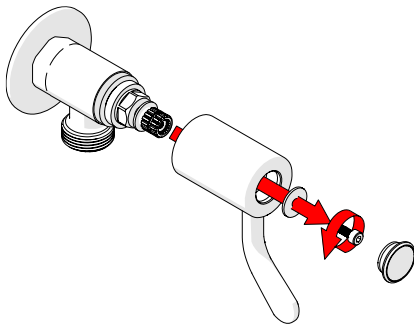


BASIN/SINK INSTALLATION

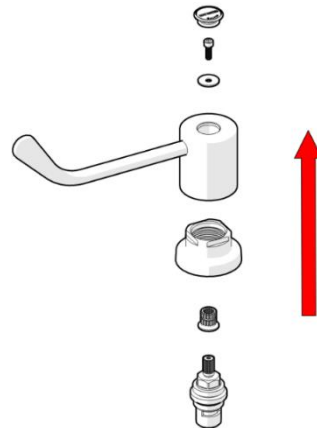


1. Remove Handle

- Prior to installation, turn off the water supply.
- Remove the handle assembly. To prevent damage, carefully pry off plastic indicator from the handle. (Use a small flat bladed screwdriver if necessary).

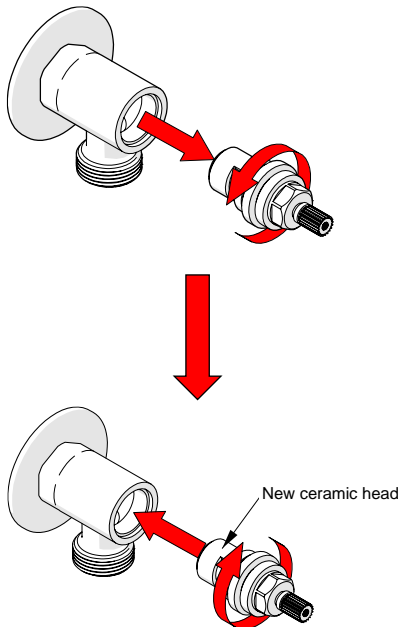

IN WALL INSTALLATION

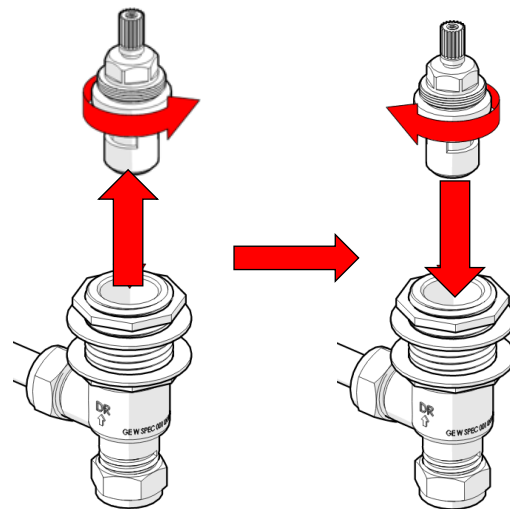


BASIN/SINK INSTALLATION

2. Replace spindle assembly
 - Unscrew the ceramic disc/jumper valve headpart from the threaded sleeve using a suitable spanner.
 - Check seat inside tap body for pitting or damage. Re-seat if necessary
3. Refit new ceramic disc/jumper valve headpart
 - Refit new headpart into tap body.




Note: Do not tighten cartridge using the handle as this will result in damage to the cartridge

IN WALL INSTALLATION

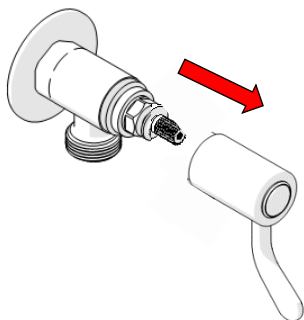

BASIN/SINK INSTALLATION

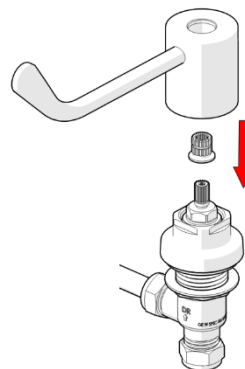

4. Reassemble Handle
 - Refit adaptor and reassemble handle by reversing step 1 and 2.
 - When installation is complete, slowly open water supply and inspect for leaks.

TROUBLESHOOTING

PROBLEM	CAUSE	RECTIFICATION
Taps are dripping water	Ceramic discs/Jumper valves are worn or damaged	Remove and inspect SBA. Remove debris and/or replace SBA if damaged.
	Tap seat is damaged	Refurbish tap seat using a reseating tool.
Water is not flowing from tap	Water supply is turned off	Turn on water supply
	Ceramic discs/Jumper valves are worn or damaged	Remove and inspect SBA. Remove debris and/or replace SBA if damaged.
Spindle is difficult to turn	Ceramic discs/Jumper valves are worn or damaged	Remove and inspect SBA. Remove debris and/or replace SBA if damaged.
Handle is loose	Screw has come loose	Tighten handle screw

WARRANTY

Galvin Engineering products are covered under our Manufacturer's Warranty. Galvin Engineering products must be installed in accordance with the installation instructions and in accordance with AS 3500 and NCC Volume Three, relevant Australian Standards and local authorities applicable to product being installed. Water and electrical supply conditions must also comply to the applicable national and/or state standards, failing to comply with these provisions may void the product warranty and affect performance of the product.

Please visit www.galvinengineering.com.au to view the full warranty, our Installation Compliance and Maintenance & Cleaning information as well as any other additional information.

Within Australia: **1300 514 074** Outside Australia: P: **+61 (0)8 9338 2344**

F: **+61 (0)8 9338 2340**

sales@galvinengineering.com.au

www.galvinengineering.com.au

ABN: 78 008 719 382

PERTH | SYDNEY | MELBOURNE | BRISBANE | ADELAIDE

