

## Product Installation Guidelines

# GalvinCare® CP-BS Lead Safe™ Safe-Connect Shower

### PRODUCT CODES:


- 121.36.64.00 (Shower Head)
- 121.36.64.92 (Shower Head with Hand Shower)



(Shower Head)



(Shower Head w/ Hand Shower)



### SPECIFICATIONS

- The GalvinCare® Safe-Connect Shower provides anti-vandalism and anti-ligature features.
- Constructed from light duty components and comes complete with special tamper resistant screws.
- Special consideration may be required when used with low water pressure systems and components.
- The 121.36.64.92 unit is supplied with a detachable hand shower.
- Chrome plate finish.
- Australian Patent No. AU 2017100421. International Patents Pending.
- Lead Safe™ brass construction. \*

**IMPORTANT:** All GalvinCare® Safe-Connect Showers are tested in accordance with AS/NZS 3662 and leave our premises in good working order.

\*Our Lead Safe™ product range is compliant with the Lead Free Requirements of the NCC 2022 Vol. Three, Clause A5G4(2) and NSF/ANSI 372.

\*\*Any flow controller incorporated in the outlet to be tightened to prevent removal by hand. As Per AS3718.

**WARNINGS:** Special attention to be paid on notes, photos, images, or drawings of assembly steps marked with the warning symbol.




### TECHNICAL DATA

Inlet	G ½ - Female	
Outlet	Shower Rose	
	Safe-Connect Shower	
Headwork	N/A	
Working Pressure Range (kPa)	Min	150
	Max	500
Working Temperature Range (°C)	Min	5
	Max	65
Nominal Flow Rate (LPM)	121.36.64.00	5.3
	121.36.64.92	5.8
Finish	Chrome	

**NOTE:** Galvin Engineering continually strive to improve their products. Specifications may change without notice.

**PRE-INSTALLATION (MOUNTING DETAILS)**


- If the mounting holes do not already exist, mark out and drill the holes as shown in rough-in dimensions.  
Note: Drill size shown is to suit supplied wall anchors. One mounting hole is acceptable.
- Ensure G ½ male spud protrudes between 10 - 15mm from the finished wall face.
- Recommended installation height is 1800mm (1.8m) from floor level to hand shower connection.
- Before installation all lines must be flushed.

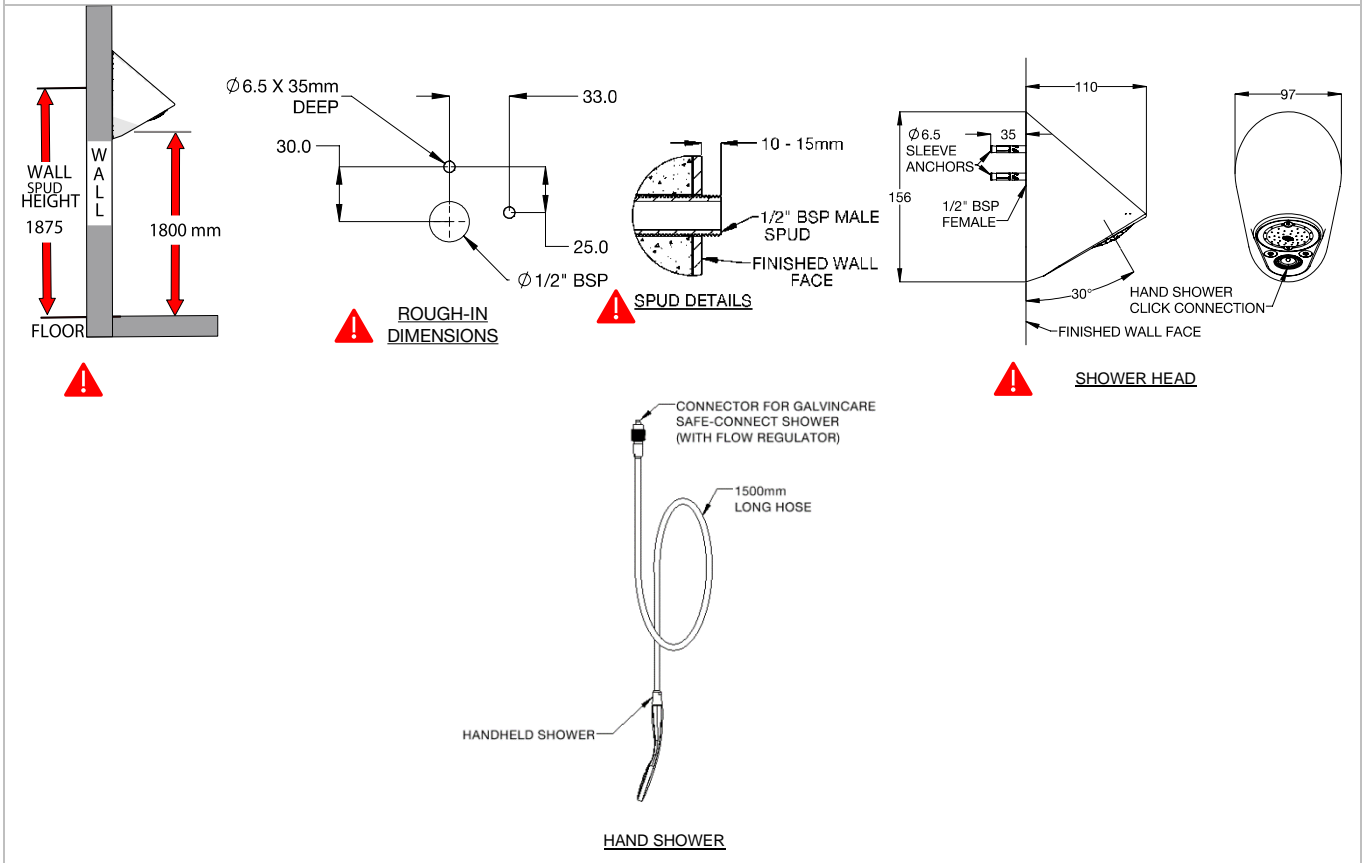

**INSTALLATION**


**INSTALLATION COMPLIANCE:** Galvin Engineering products must be installed in accordance with these installation instructions and in accordance with AS/NZS 3500, the PCA and your local regulatory requirements. Water and/or electrical supply conditions must also comply to the applicable national and/or state standards. Failing to comply with these provisions shall void the product warranty and may affect the performance of the product.

**IMPORTANT:** Whilst our product designs take into account a broad range of installation types and surfaces, it is important that surfaces which fixtures are mounted to are flat and free from defect. Additionally, ensure any protruding connecting thread is square to the wall so that the outlet sits flat against the wall when installed, ensuring that there are no gaps between the wall and outlet. This is especially important when installing product ranges that have been designed for correctional and health facilities, where special attention is required to minimise ligature points and areas for concealment of contraband. In addition to ensuring the products are fitted securely and in accordance with the following instructions, consideration shall be given to the use of non-pick mastics such as BASF Sonolastic "Ultra" to ensure a high quality and safe installation.




**1. Fit retaining nut**

- Screw the retaining nut onto the spud until the rear face is touching the wall. Ensure to use thread sealant/tape.

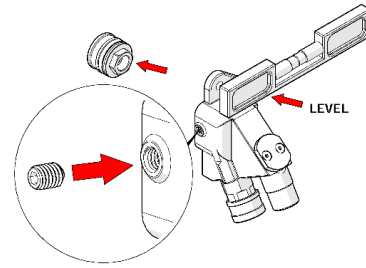

**2. Fit shower body**


- Fit shower body onto retaining nut until it touches the wall.
- Ensure body is level and tighten grub screw to lock. Take care not to overtighten.



**3. Secure shower body**

- Secure body with the two supplied M6.5 wall anchors as shown.

**!** It is acceptable to use only one mounting hole for securing the body if space is limited.

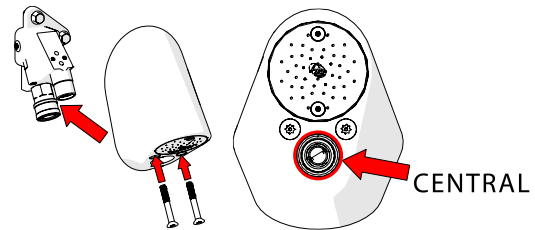


**4. Fit shower outer case and check operation**

- Fit the shower outer case onto body as shown.
- Fit the two screws as shown and tighten evenly to ensure fitting location is central – do not over tighten.

**!** Take care to not shear o-ring on outer case while fitting.


- Turn on water to check correct function of wall shower, then turn off water.

**!** Note: This wall shower is fitted with a flow restrictor. Never operate without a flow restrictor, as outlet will deliver full mains pressure with unrestricted flow.

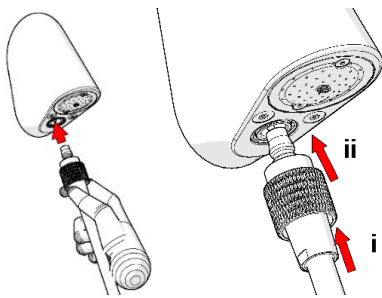

**6. Connect hand shower (121.36.64.92 only)**

- Push the hose connection into the wall fitting.
  - With one hand, maintain pressure to the hose.
  - With the other hand, push the outer ring forward as shown.
- The hose should now move further forward into the wall fitting.
- While still applying pressure to the hose release the outer ring.

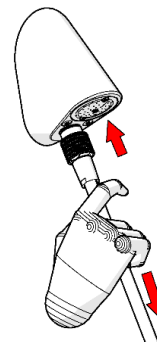

**7. Check hand shower operation (121.36.64.92 only)**

- Check that the hose is securely connected.
- Turn on water supply, the hand shower should now be working, and the wall shower should not be running.
- Turn off water.
- To remove hose, push the outer ring forward and pull downwards.

TROUBLESHOOTING		
PROBLEM	CAUSE	RECTIFICATION
Wall shower is dripping water	Headworks are worn or damaged	Remove and inspect the headworks, remove debris and/or replace o-rings or parts if damaged
	Diverter assembly is worn or damaged	Remove and inspect the diverter assembly, remove debris and/or replace O-rings or parts if damaged
Wall shower has inconsistent flow	Blocked flow restrictor	Remove flow regulator from body and remove debris. Install an inline strainer to stop further blockages.
Leak from behind body	Insufficient sealant	Apply more thread tape or sealant to create a better seal

**WARRANTY**

Galvin Engineering products are covered under our Manufacturer's Warranty. Galvin Engineering products must be installed in accordance with the installation instructions and in accordance with AS 3500 and NCC Volume Three, relevant Australian Standards and local authorities applicable to product being installed. Water and electrical supply conditions must also comply to the applicable national and/or state standards, failing to comply with these provisions may void the product warranty and affect performance of the product.

Please visit [www.galvinengineering.com.au](http://www.galvinengineering.com.au) to view the full warranty, our Installation Compliance and Maintenance & Cleaning information as well as any other additional information.

*In the absence of a legal or industry definition of anti-ligature or ligature resistant products, when we use these terms, we are referring to products that are designed and manufactured with the intention of reducing the risk of ligature attachment to the product(s).*

*Galvin Engineering Pty Ltd will always endeavour to design and test our anti-ligature product(s) to reduce the risk of product ligature attachment that may result in serious injury or death.*

*Whilst all reasonable measures are taken at the time of design, the anti-ligature design of the products are not intended to and will not:*

- a. Replace protective measures that need to be taken in the specific circumstances of usage;*
- b. Substitute the need for supervision of those who may be at risk;*
- c. Protect and or prevent those at risk against any self-harm instances that may occur when installed; and*
- d. Protect and or prevent injury when the risks were unknown to us at the time of the design of the product(s).*

*Galvin Engineering Pty Ltd does not offer and does not represent or warrant that any product(s) for sale that are ligature-free.*

*Therefore, Galvin Engineering will not be liable for any claims, loss, or damages arising from ligature attachment on our products. It is the purchaser's responsibility to ensure that products purchased and installed are suitable for the environments in which they are installed, and suitable supervision and protective measures are in place to protect those at risk.*

Within Australia: 1300 514 074 Outside Australia: P: +61 (0)8 9338 2344

F: +61 (0)8 9338 2340

sales@galvinengineering.com.au

[www.galvinengineering.com.au](http://www.galvinengineering.com.au)

ABN: 78 008 719 382

PERTH | SYDNEY | MELBOURNE | BRISBANE | ADELAIDE

