


Product Installation Guidelines & Scope of Use

Version 2, 28 August 2025, Page 1 of 2
Document No.: 181.93.00.00

Ezy-Wash® Lead Safe Pre-Rinse Hand Trigger Spray



PRODUCT CODE:

- 181.93.00.00

SPECIFICATIONS

- Galvin Engineering recommends the installation of strainers and pressure reducing valves prior to installing the pre-rinse unit to ensure clean consistent supply. Debris or poor water quality could cause the trigger to seize or fail to seal.
- Lead Safe™ brass construction. *

IMPORTANT: All items are tested in accordance with AS 3718 and leave our premises in good working order.

*Our Lead Safe™ product range is compliant with the Lead-Free Requirements of the NCC 2022 Vol. Three, Clause A5G4(2) and NSF/ANSI 372.
** Any flow controller incorporated in the outlet to be tightened to prevent removal by hand. As Per AS3718.

WARNINGS: Special attentions to be paid on notes, photos, images, or drawings of assembly steps marked with the warning symbol.




TECHNICAL DATA

Inlet connections	1/2" BSP – Male	
Outlet connections	Trigger Spray	
Headwork	N/A	
Working Pressure Range (kPa)	Min	100
	Max	400
Working Temperature Range (°C)	Min	5
	Max	65
Nominal Flow Rate (LPM)	4.3	
Finish	Chrome	

NOTE: Galvin Engineering continually strives to improve their products. Specifications may change without notice.


PRE-INSTALLATION

- Before installation, all lines must be flushed.

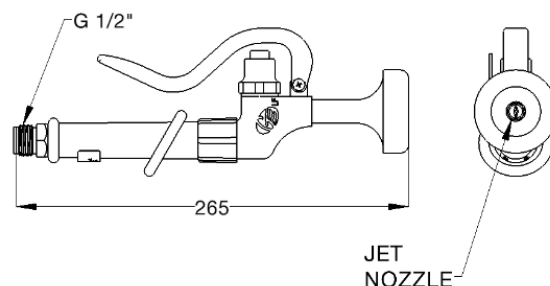

INSTALLATION

INSTALLATION COMPLIANCE: Galvin Engineering products must be installed in accordance with these installation instructions and in accordance with AS/NZS 3500, the PCA and your local regulatory requirements. Water and/or electrical supply conditions must also comply to the applicable national and/or state standards. Failing to comply with these provisions shall void the product warranty and may affect the performance of the product.



1. Fit Trigger spray

- Fit trigger spray to the end of the hose.
- Ensure rubber washer is used between the trigger and the hose.
- Ensure the female socket on the hose is clean and free from debris.
- It is recommended to use Loctite 577 or an equivalent sealant compliant with AS/NZS 4020.
- Do not use thread tape as this may cause the hose nut to become loosened overtime and leak.



Note: Additional fibre washers are included, if needed, and should be used as required to ensure a proper seal.



2. Test unit

- Once fitting is tightened securely and connected to the mains water, test the unit for any leaks.

WARNINGS



For optimum performance it is recommended that the isolation or mains taps are turned off whilst the unit is not in use (overnight etc.), so that the unit is not under mains pressure when unsupervised. Flood damage may occur if a failure occurs whilst the unit is under mains pressure (warranty is void in this instance).

If a blockage occurs, remove the nozzle for cleaning, then replace. Do not try to remove the entire spray head.



Galvin Engineering recommends that the hand piece is periodically serviced by a qualified plumber.



If hose is to be removed for maintenance purposes, follow the steps above for reinstallation.

WARRANTY

Galvin Engineering products are covered under our Manufacturer's Warranty. Galvin Engineering products must be installed in accordance with the installation instructions and in accordance with AS/NZS 3500 and NCC Volume Three, relevant Australian Standards and local authorities applicable to product being installed. Water and electrical supply conditions must also comply to the applicable national and/or state standards, failing to comply with these provisions may void the product warranty and affect performance of the product.

Please visit www.galvinengineering.com.au to view the full warranty, our Installation Compliance and Maintenance & Cleaning information as well as any other additional information.

Within Australia: 1300 514 074 Outside Australia: P: +61 (0)8 9338 2344

F: +61 (0)8 9338 2340

sales@galvinengineering.com.au

www.galvinengineering.com.au

ABN: 78 008 719 382

PERTH | SYDNEY | MELBOURNE | BRISBANE | ADELAIDE

